


Wall-Mounted Ventilator with Sound Absorption

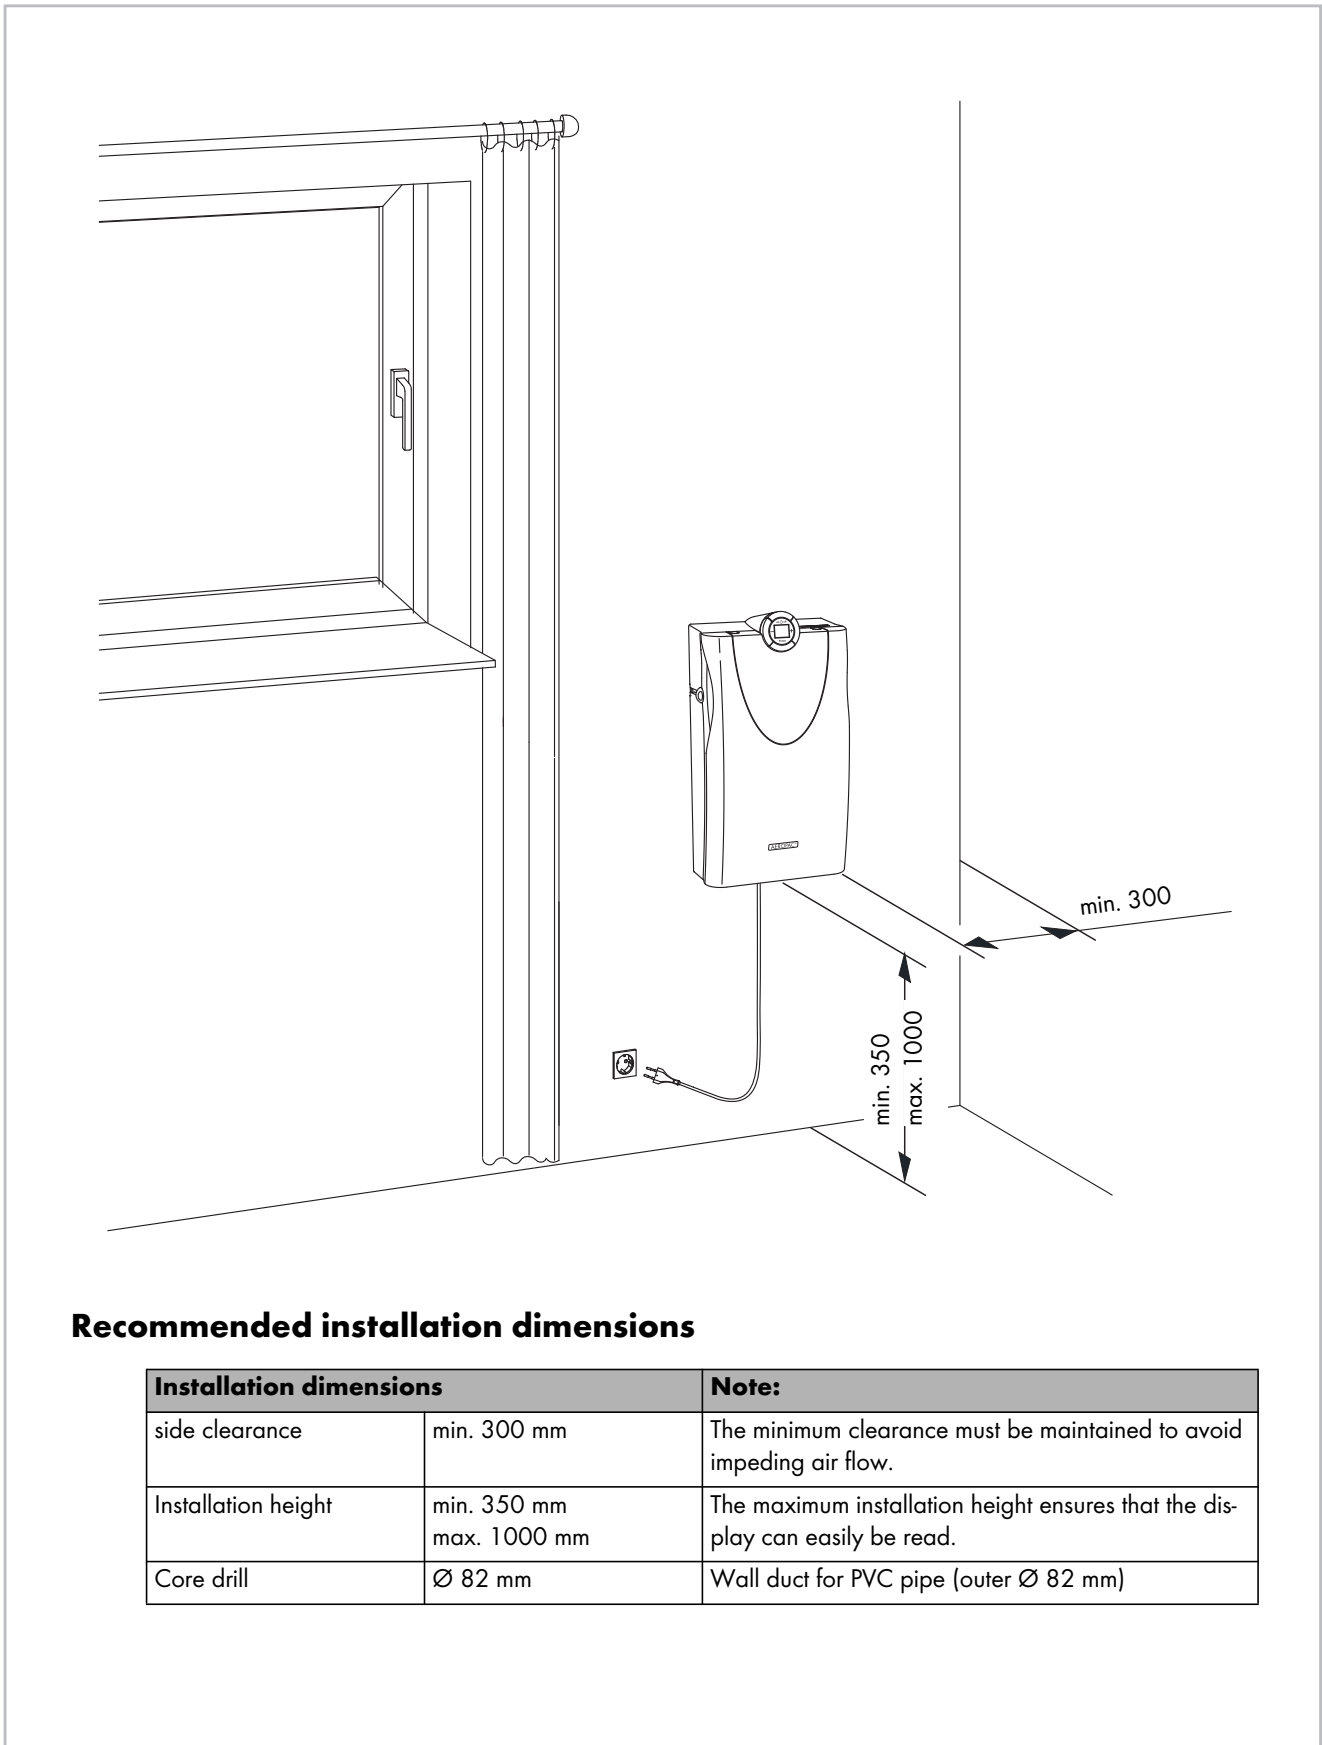

Recommended installation dimensions

Installation dimensions		Note:
side clearance	min. 300 mm	The minimum clearance must be maintained to avoid impeding air flow.
Installation height	min. 350 mm max. 1000 mm	The maximum installation height ensures that the display can easily be read.
Core drill	Ø 82 mm	Wall duct for PVC pipe (outer Ø 82 mm)

Technical specifications and colours are subject to change.

H43.WANSIAU0001EN/0